


LaPlant
Architecture, LLC

OFFICE: 926 WILLARD DRIVE
GREEN BAY, WISCONSIN
MAILING: 1592 RUSTIC WAY
GREEN BAY, WISCONSIN 54313
Telephone: (920) 737-9769
EMAIL:
laplantarchitecture@yahoo.com

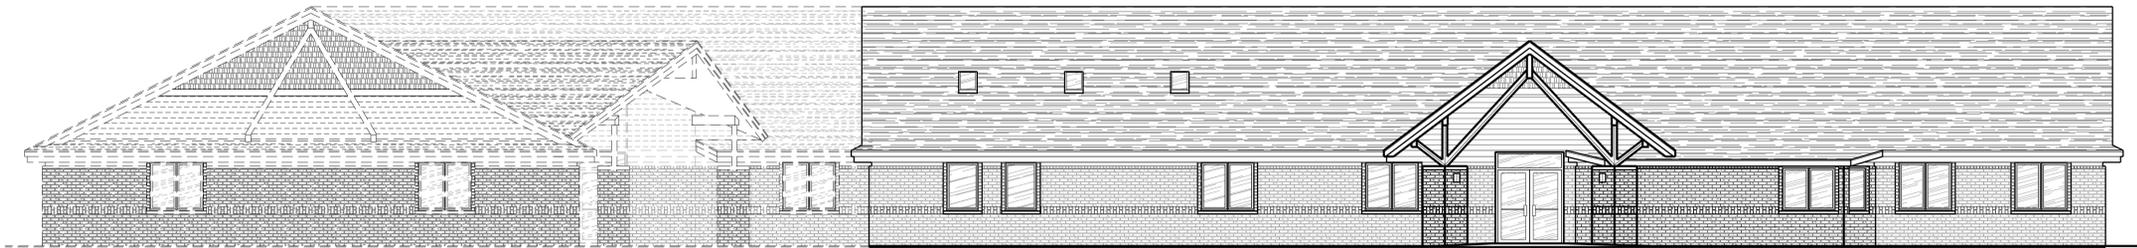

PROPOSED BUILDING - COMPOSITE
FRONT ELEVATION

SCALE: 1/8" = 1'-0"



PROPOSED BUILDING
FRONT ELEVATION

SCALE: 1/4" = 1'-0"

ELEVATION NOTES:
BUILDING MATERIAL PERCENTAGE
OF FACADE

- BRICK 875 S.F. 84 %
- LAP SIDING 90 S.F. 4 %
- SHAKE SIDING 15 S.F. 2 %

TOTAL 100%



PROPOSED BUILDING
SOUTH ELEVATION

SCALE: 1/4" = 1'-0"

ELEVATION NOTES:
BUILDING MATERIAL PERCENTAGE
OF FACADE

- BRICK 380 S.F. 61 %
- LAP SIDING 160 S.F. 26 %
- SHAKE SIDING 85 S.F. 13 %

TOTAL 100%

**Stansbury &
Brady, LLC**

**Orthopedic
Spine Therapy**

OFFICE: 4000 N. PROVIDENCE
APPLETON, WI 54913
Telephone: (920) 257-2005
EMAIL:
abarnett@ostpt.com


**ORTHOPEDIC
SPINE THERAPY**

REVISION	DATE
x	xxx

DATE
9/5/2015
PROJECT NO.
451002

SHEET
**A
1.1**

PRELIMINARY
NOT FOR CONSTRUCTION



LaPlant
Architecture, LLC

OFFICE: 926 WILLARD DRIVE
GREEN BAY, WISCONSIN
MAILING: 1592 RUSTIC WAY
GREEN BAY, WISCONSIN 54313
Telephone: (920) 737-9769
EMAIL:
laplantarchitecture@yahoo.com



PROPOSED BUILDING - COMPOSITE
EAST ELEVATION
SCALE: 1/8" = 1'-0"




ELEVATION NOTES:
BUILDING MATERIAL PERCENTAGE
OF FACADE

- BRICK 875 S.F. 92%
- LAP SIDING 70 S.F. 7%
- SHAKE SIDING 7 1%

TOTAL 100%

PROPOSED BUILDING
EAST ELEVATION
SCALE: 1/4" = 1'-0"

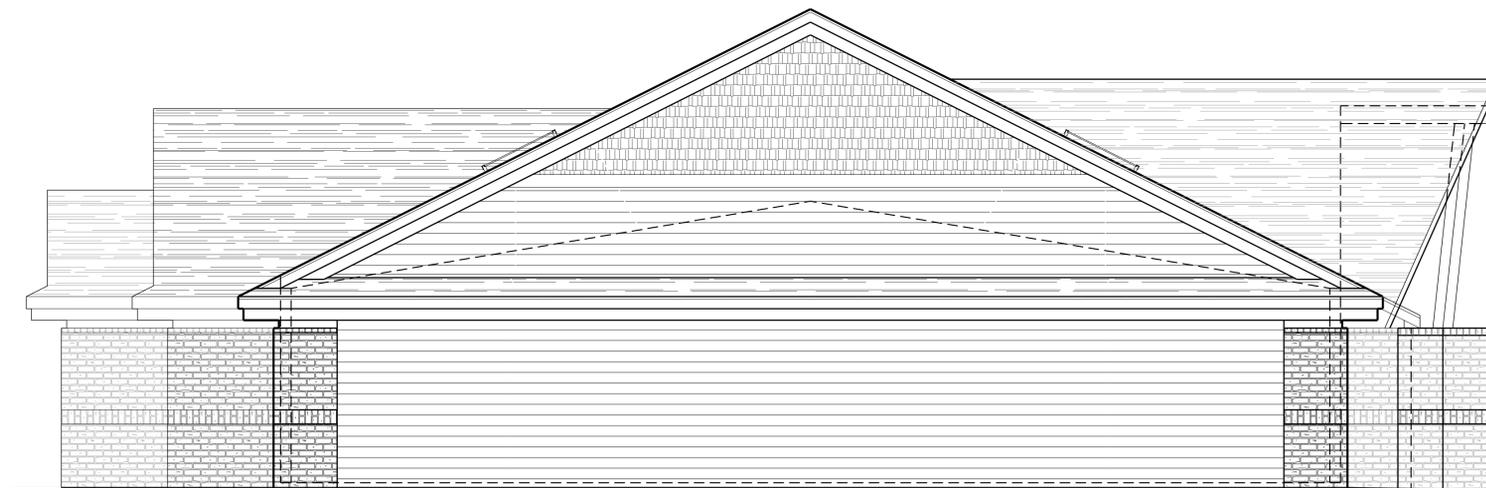

PROPOSED BUILDING
NORTH ELEVATION
SCALE: 1/4" = 1'-0"

PRELIMINARY
NOT FOR CONSTRUCTION

**Stansbury &
Brady, LLC**
**Orthopedic
Spine Therapy**
OFFICE: 4000 N. PROVIDENCE
APPLETON, WI 54913
Telephone: (920) 257-2005
EMAIL:
abarnett@ostpt.com


ORTHOPEDIC
SPINE THERAPY

REVISION	DATE
x	xxx

DATE
9/5/2015


PROJECT NO.
451002

SHEET
A
1.2



LaPlant
Architecture, LLC

OFFICE: 926 WILLARD DRIVE
GREEN BAY, WISCONSIN
MAILING: 1592 RUSTIC WAY
GREEN BAY, WISCONSIN 54313
Telephone: (920) 737-9769
EMAIL: laplantarchitecture@yahoo.com

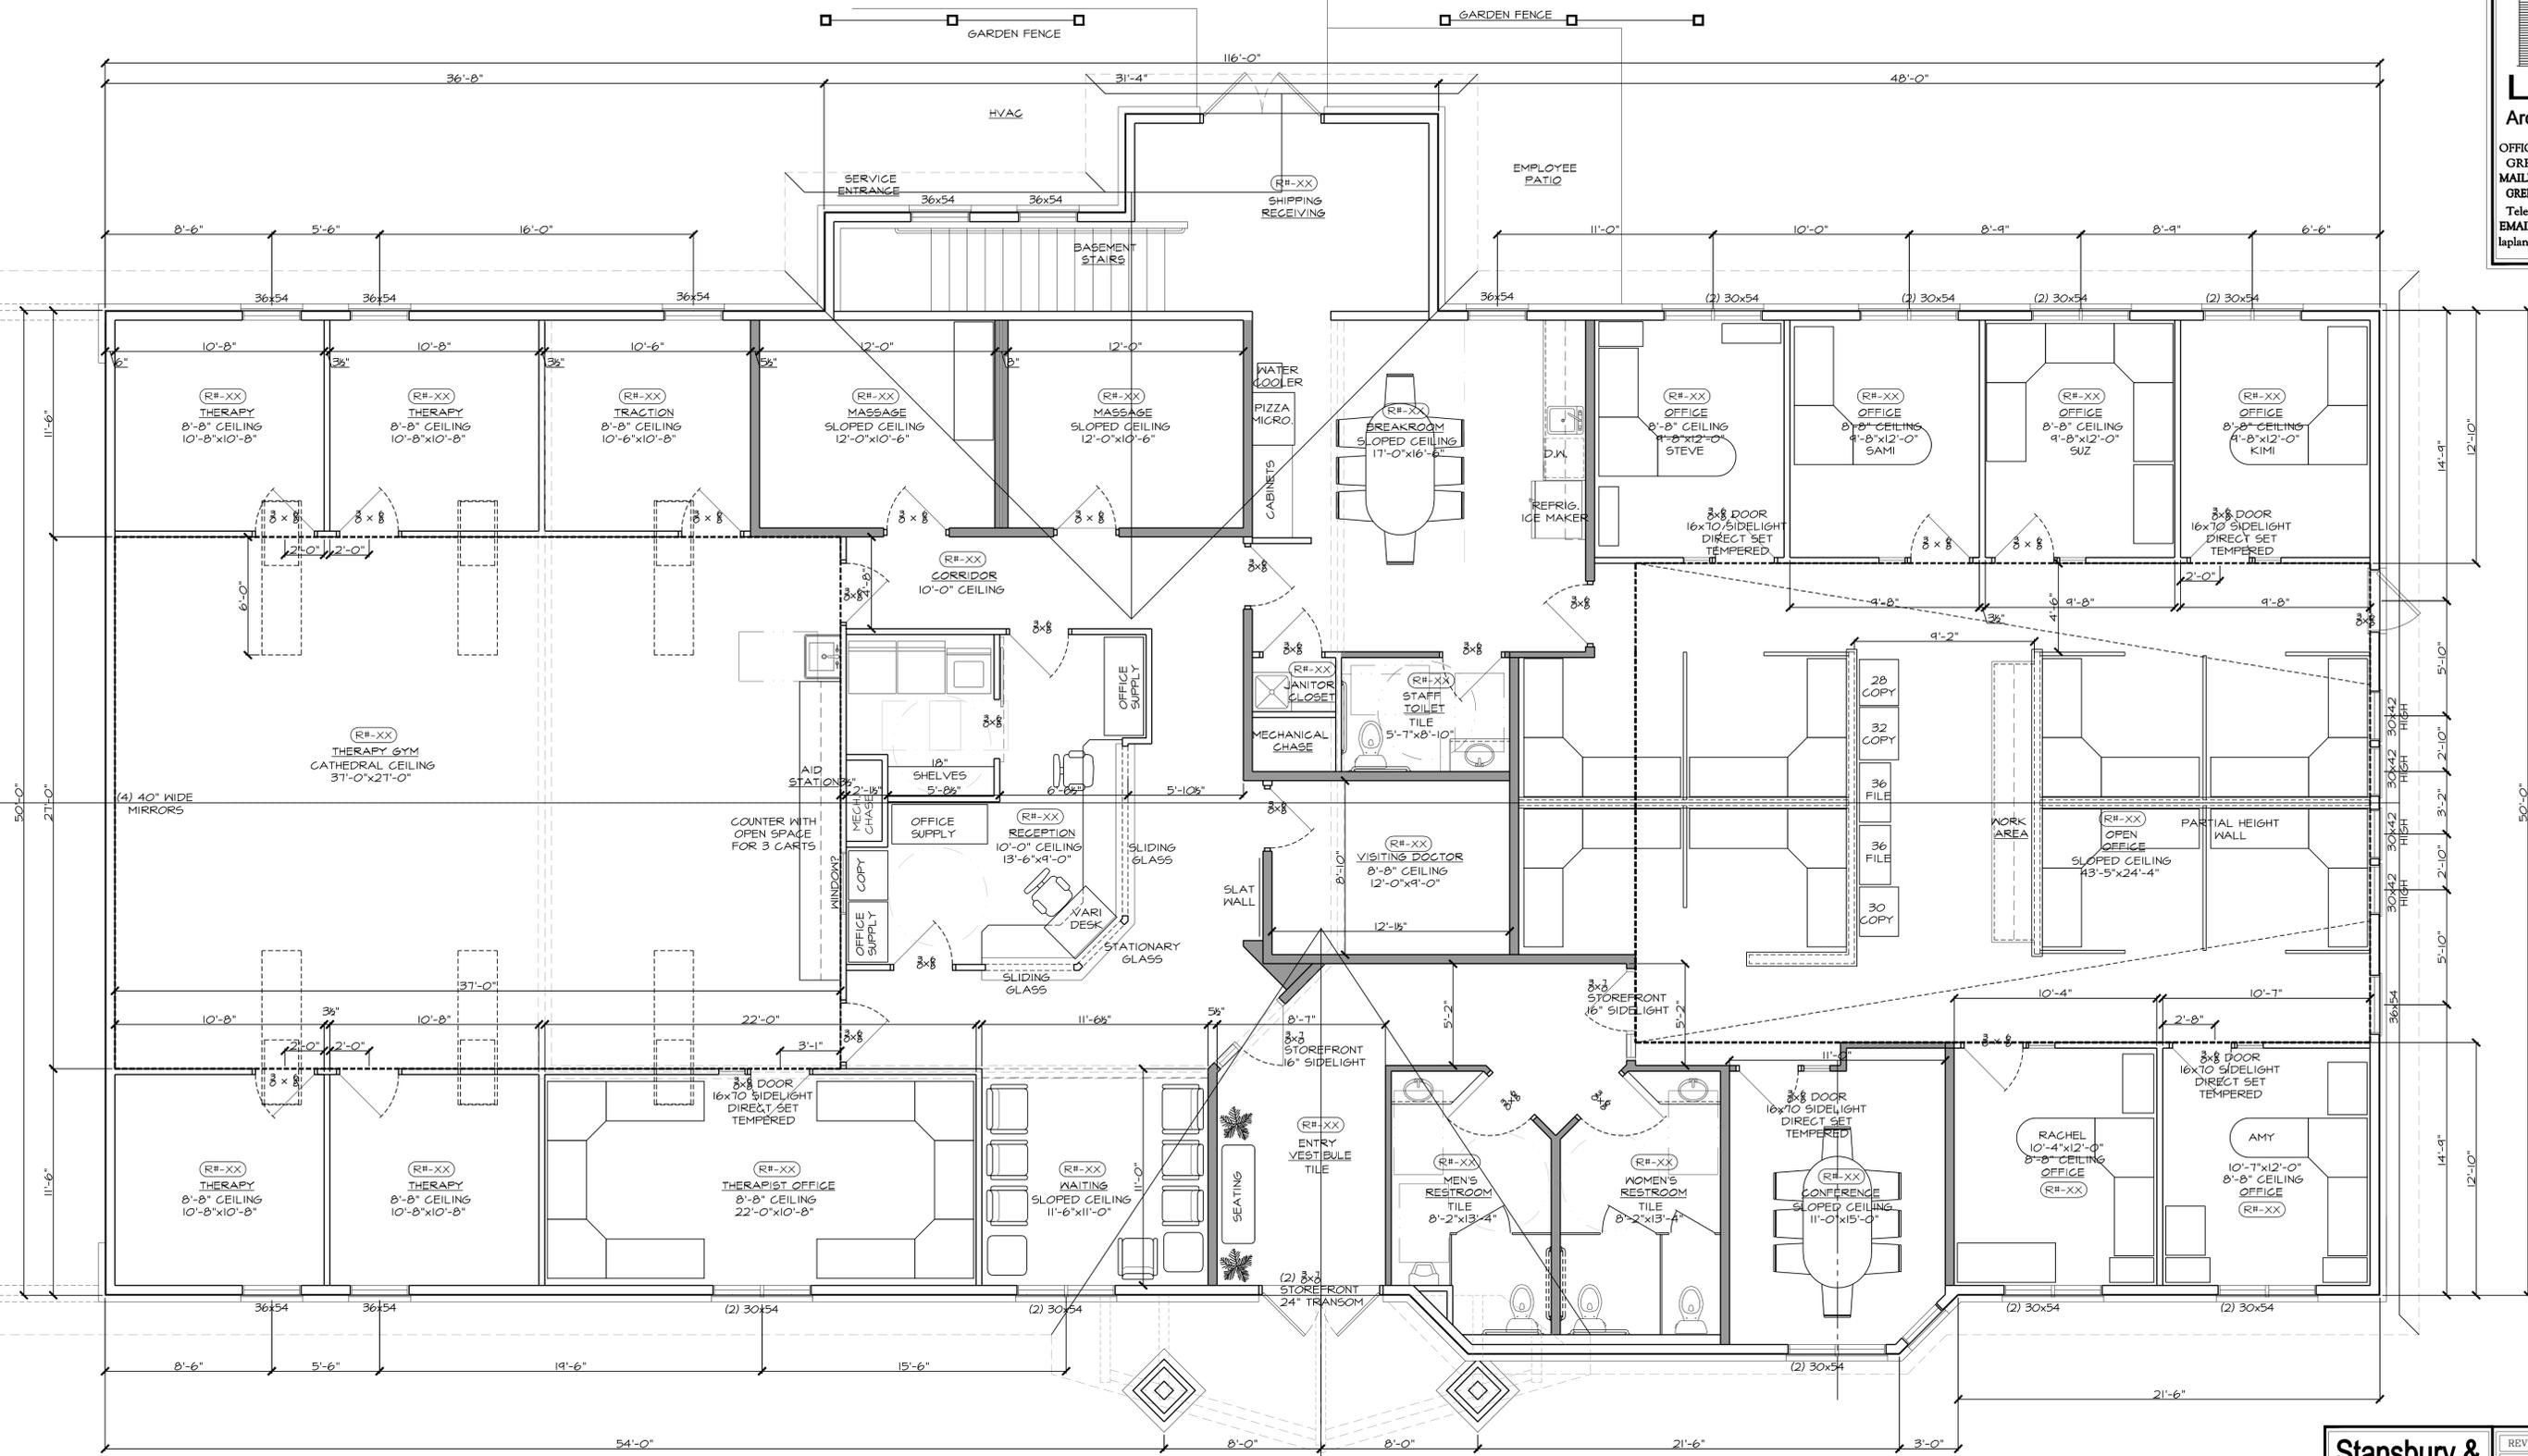

FLOOR PLAN

SCALE: 1/4" = 1'-0"




Stansbury & Brady, LLC
Orthopedic Spine Therapy
OFFICE: 4000 N. PROVIDENCE
APPLETON, WI 54913
Telephone: (920) 257-2005
EMAIL: abarnett@ostpt.com



REVISION	DATE
x	xxx

DATE: 9/5/2015
PROJECT NO.: 451002
SHEET: **A 2.1**

PRELIMINARY
NOT FOR CONSTRUCTION



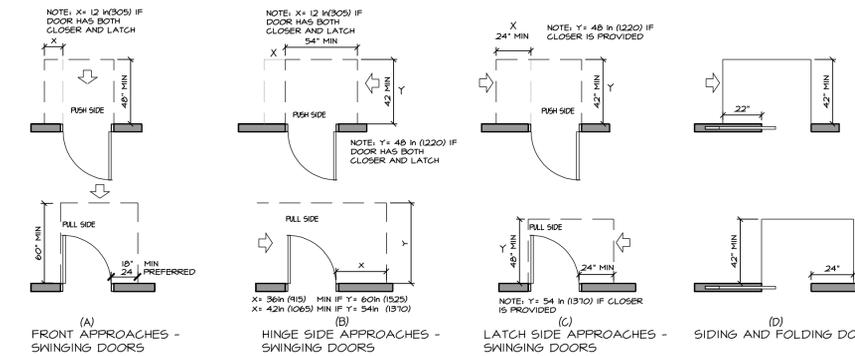
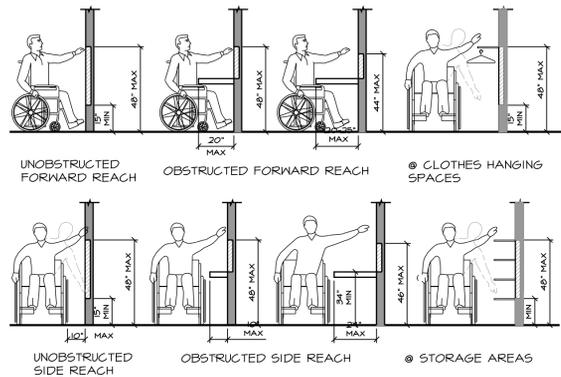
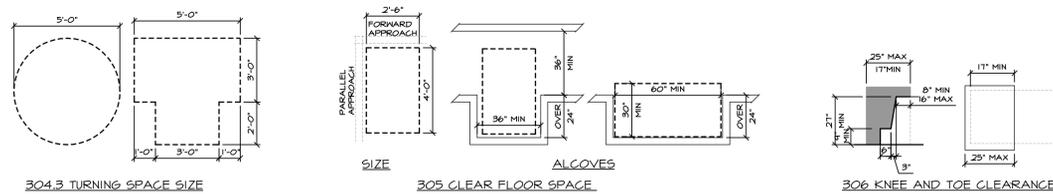


308 STANDARD REACH HEIGHTS
 NOT TO SCALE

404.2.3 MANEUVERING CLEARANCES AT DOORS

NOTE: ALL DOOR HANDLES SHALL BE LEVER OR LOOP TYPE

ICC/ANSI A117.1; Sec. 404.2.3 FOR ADDITIONAL DOOR TYPES
 ICC/ANSI A117.1; Sec. 404.2.5 FOR DOORS IN A SERIES

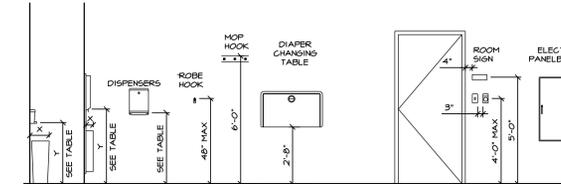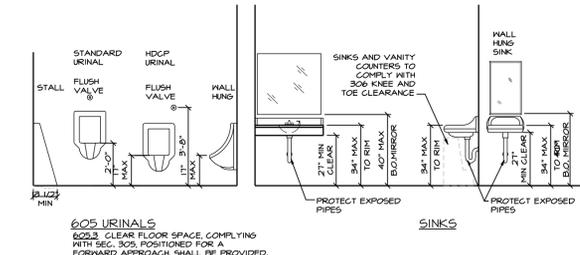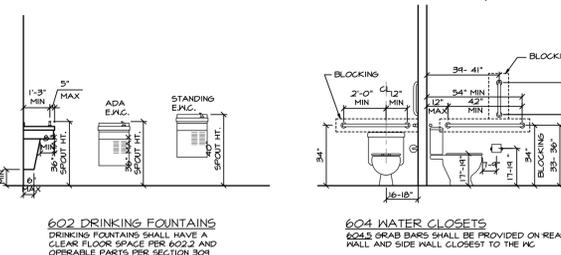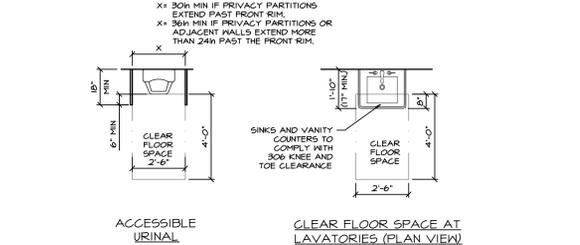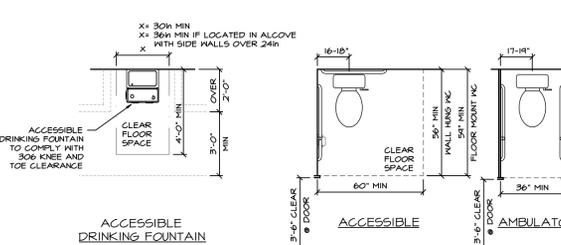


PLUMBING FIXTURES AND MOUNTING HEIGHTS

ACCESSIBLE RAMPS
 SCALE: 1/2" = 1'-0"

GENERAL NOTES - RAMP:

406.6 LOCATION. RAMPS AND FLARED SIDES SHALL BE LOCATED SO THEY DO NOT PROJECT INTO VEHICULAR TRAFFIC LANES OR PARKING SPACES.
 OBSTRUCTIONS. LOCATE TO PREVENT OBSTRUCTION BY PARKED CARS.

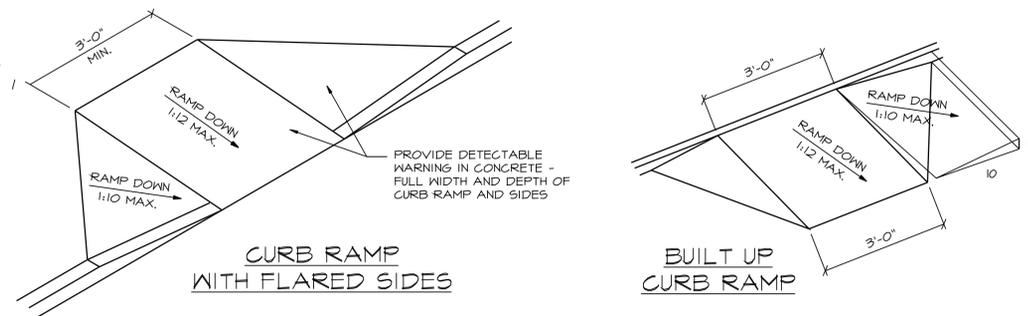

NOTES FOR ACCESSIBILITY

GENERAL NOTES

- ICC/IBC - 2009 AND ICC/ANSI A117.1 - 2003 ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES
- ICC/ANSI A117.1 - 2003; Sec. 302.1- GENERAL. FLOOR SURFACES SHALL BE STABLE, FIRM AND SLIP RESISTANT. CARPET OR CARPET TILES SHALL COMPLY WITH Sec. 302.2. OPENINGS IN FLOOR SHALL COMPLY WITH Sec. 302.3.
- ICC/ANSI A117.1-2003; Sec. 303.2- CHANGES IN LEVEL IN FLOOR SURFACES. 1/4" MAX. VERTICAL CHANGE IN HEIGHT IS PERMITTED. CHANGES IN HEIGHT GREATER THAN 1/4" AND NOT MORE THAN 1/2" MAX. SHALL BE BEVELED WITH A SLOPE NOT STEEPER THAN 1:2.
- ICC/ANSI A117.1-2003; Sec. 304- OPERABLE PARTS, SUCH AS FAUCETS, CONTROLS, WATER CLOSET AND URINAL FLUSH CONTROLS, LIGHT SWITCHES, ELECTRICAL RECEPTACLES, CIRCUIT BREAKERS, AND OTHER CONTROLS SHALL COMPLY WITH SEC. 304. HAVE A 30"x48" CLEAR FLOOR SPACE AND BE 15" A.F.F. MIN. / 48" A.F.F. MAX. OPERABLE PARTS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE SHALL BE 5.0 LB MAXIMUM. APPLIANCE CONTROLS AND CIRCUIT BREAKERS IN TYPE "A" UNITS SHALL ALSO COMPLY.
- ICC/ANSI A117.1-2003; Sec. 404 - DOORS AND DOORWAYS THAT ARE PART OF AN ACCESSIBLE ROUTE SHALL COMPLY WITH SEC. 404. DOORWAYS SHALL HAVE A CLEAR 32" MIN. CLEAR OPENING. DOORS SHALL HAVE A 32" MIN. CLEAR WIDTH MEASURED FROM THE JAMB TO THE FACE OF THE OPEN DOOR, WITH THE DOOR OPEN 90°, AND ADA COMPLIANT THRESHOLDS. DOORS SHALL ALSO HAVE ADA COMPLIANT LEVER HARDWARE, OPENING FORCE, CLOSING SPEED, BOTTOM DOOR SURFACE, VISION LITE AND MANEUVERING CLEARANCES.
- ICC/ANSI A117.1-2003; Sec. 404 - DOOR HARDWARE, HANDLES, PULLS, LATCHES, LOCKS, AND OTHER OPERABLE PARTS SHALL HAVE A SHAPE THAT IS EASY TO GRASP WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE SHALL BE 5.0 LB MAXIMUM. OPERABLE PARTS OF SUCH HARDWARE SHALL BE 34" A.F.F. MIN. AND 48" A.F.F. MAX.
- ICC/ANSI A117.1-2003; Sec. 506 - ACCESSIBLE WINDOWS SHALL HAVE OPERABLE PARTS THAT COMPLY WITH SEC. 304, AND SHALL INCLUDE MANEUVERING CLEARANCES, REACH RANGES, AND GRASPABILITY OF MECHANISMS.
- ICC/IBC 2009; Sec. 1210.1 - FLOORS AND WALL BASE FINISH MATERIALS. (IN OTHER THAN DWELLING UNITS) TOILET, BATHING AND SHOWER ROOM FLOOR FINISH MATERIALS SHALL HAVE A SMOOTH, HARD, NONABSORBENT SURFACE. THE INTERSECTIONS OF FLOOR AND WALLS SHALL HAVE A SMOOTH, HARD, NONABSORBENT VERTICAL BASE THAT EXTENDS UPWARD ONTO THE WALL AT LEAST 4 INCHES.
- ICC/IBC 2009; Sec. 1210.2 - WALLS AND PARTITIONS. WALLS AND PARTITIONS WITHIN 2 FT. OF URINALS AND WATER CLOSETS SHALL HAVE A SMOOTH, HARD, NONABSORBENT SURFACE, TO A HEIGHT OF 4 FT. A.F.F. AND MATERIALS USED AND SHALL NOT BE ADVERSELY AFFECTED BY MOISTURE.
 - DWELLING UNITS AND SLEEPING UNITS
 - TOILET ROOMS THAT ARE NOT ACCESSIBLE TO THE PUBLIC AND WHICH HAVE NOT MORE THAN ONE WC.



PLAN NOTES (SEE PLUMBING FIXTURE AND MOUNTING HEIGHTS FOR ADDITIONAL INFORMATION)

- ICC/ANSI A117.1-2003; Sec. 602 - ACCESSIBLE DRINKING FOUNTAINS SHALL COMPLY INCLUDING CLEAR FLOOR SPACE, OPERABLE CONTROLS, SPOUT OUTLET HEIGHT AND LOCATION, AND WATER FLOW.
- ICC/ANSI A117.1-2003; Sec. 603.3 - MIRRORS. MIRRORS LOCATED ABOVE LAVATORIES, SINKS OR COUNTERS SHALL BE MOUNTED WITH THE BOTTOM EDGE OF THE REFLECTING SURFACE 40" MAX. A.F.F.
- ICC/ANSI A117.1-2003; Sec. 604.11 4 Sec. 803.5 - COAT HOOKS AND SHELVES. ACCESSIBLE COAT HOOKS SHALL BE 48" MAX. A.F.F. WHERE PROVIDED, SHELVES SHALL BE 40" MIN. AND 48" MAX. A.F.F.
- ICC/ANSI A117.1-2003; Sec. 604 - ACCESSIBLE WATER CLOSETS AND COMPARTMENTS SHALL COMPLY INCLUDING WC LOCATION, CLEARANCE, HEIGHT OF WATER CLOSET SEAT, GRAB BARS AND OPERABLE CONTROLS. FLUSH CONTROLS SHALL BE ON THE OPEN SIDE OF THE ACCESSIBLE WC.
- ICC/ANSI A117.1-2003; Sec. 605 - ACCESSIBLE URINALS SHALL BE A STALL TYPE, WITH A MIN. DEPTH OF 13 1/2" (340mm) FROM THE OUTER FACE OF THE RIM TO THE BACK SURFACE OF THE FIXTURE, OR A WALL HUNG TYPE, WITH THE RIM HEIGHT AT 17" (430mm) MAX. A.F.F. URINALS SHALL HAVE A CLEAR FLOOR SPACE, POSITIONED FOR A FORWARD APPROACH, AND CONTROLS THAT COMPLY WITH SEC. 304
- ICC/ANSI A117.1-2003; Sec. 606 - ACCESSIBLE LAVATORIES AND SINKS SHALL COMPLY WITH SEC. 606 AND SHALL BE 34" MAX. HEIGHT A.F.F. MEASURED TO THE SINK RIM OR COUNTER SURFACE IF UNDER-COUNTER. PROVIDE CLEAR FLOOR SPACE, POSITIONED FOR FORWARD APPROACH AND CENTERED ON ONE SINK BOWL, KNEE AND TOE CLEARANCE, AND EXPOSED PIPE PROTECTION. CLEAR FLOOR SPACE SHALL BE 30" MIN. WIDTH AND 36" MIN. WIDTH IF USED FOR TURNING TURNING SPACE. FAUCETS SHALL BE WITHIN THE REACH RANGES, OPERABLE WITH ONE HAND, AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE SHALL BE 5.0 POUNDS MAX.

Sec. 606.2 EXCEPTION 1 - A PARALLEL APPROACH COMPLYING WITH SEC. 305 SHALL BE PERMITTED TO A KITCHEN SINK IN A SPACE WHERE A COOKTOP OR RANGE IS NOT PROVIDED.
- ICC/ANSI A117.1-2003; Sec. 606.7 - OPERABLE PARTS ON HAND DRYERS AND DISPENSERS SHALL COMPLY WITH TABLE 606.7. WITH THE LABORATORY AT 34" IN HEIGHT. THE TOWEL DISPENSER AND HAND DRYER MUST BE ON A SIDE WALL WHERE THE MAX. REACH DEPTH IS 11" MAX.
- ICC/ANSI A117.1-2003; Sec. 609 - GRAB BARS IN ACCESSIBLE TOILET OR BATHING FACILITIES SHALL COMPLY WITH SEC. 609 AND HAVE A CROSS SECTION COMPLYING WITH SEC. 604.2. THE SPACE BETWEEN GRAB BAR AND THE WALL OR PROJECTING OBJECTS BELOW OR AT THE ENDS OF THE BARS, SHALL BE 1 1/2" (38mm). THE SPACE BETWEEN THE GRAB BAR AND PROJECTING OBJECT ABOVE SHALL BE 12" MIN. ALL COMPONENTS OF THE GRAB BAR SHALL BE STRONG ENOUGH TO RESIST A 250 POUND CONCENTRIC FORCE APPLIED EITHER HORIZONTALLY OR VERTICALLY. GRAB BARS SHALL BE FREE OF SURFACE HAZARDS AND POSITIONED PER SEC. 609.4 AND INSTALLED PER SEC. 609.7.
- ICC/ANSI A117.1-2003; Sec. 804.6 - APPLIANCES. APPLIANCES (REFRIGERATORS, MICROWAVES, VENDING MACHINES, ETC.) SHALL HAVE A CLEAR FLOOR SPACE PER SEC. 305. CLEAR FLOOR SPACES MAY OVERLAP. ALL APPLIANCE CONTROLS SHALL COMPLY WITH SEC. 304 OPERABLE PARTS (SEE GENERAL NOTE #4) AND SHALL COMPLY WITH SEC. 308 REACH RANGES.


CRITICAL DIMENSION

Stansbury & Brady, LLC
Orthopedic Spine Therapy
 OFFICE 4000 N. PROVIDENCE APPLETON, WI 54913
 Telephone: (920) 257-2005
 EMAIL: abarnett@ostpt.com

REVISION	DATE
x	xxx


DATE: 9/5/2015
 PROJECT NO.: 451002
 SHEET: **A 2.2**

PRELIMINARY
 NOT FOR CONSTRUCTION



LaPlant
Architecture, LLC

OFFICE: 926 WILLARD DRIVE
GREEN BAY, WISCONSIN
MAILING: 1592 RUSTIC WAY
GREEN BAY, WISCONSIN 54313
Telephone: (920) 737-9769
EMAIL:
laplantarchitecture@yahoo.com

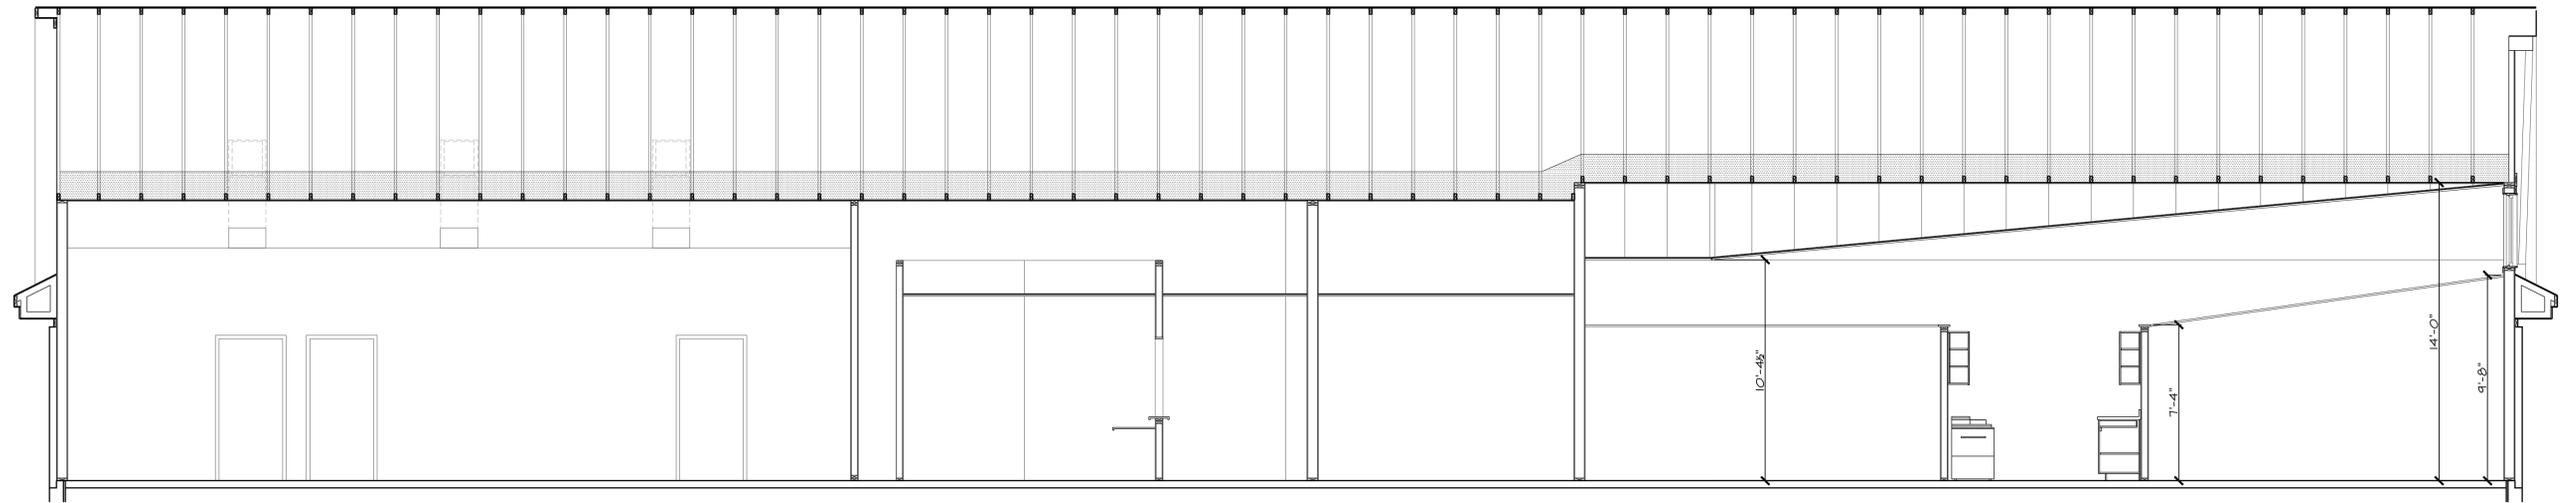

THERAPY

BUILDING SECTION
SCALE: 1/4" = 1'-0"

OPEN OFFICE

**Stansbury &
Brady, LLC**

**Orthopedic
Spine Therapy**

OFFICE: 4000 N. PROVIDENCE
APPLETON, WI 54913
Telephone: (920) 257-2005
EMAIL:
abarnett@ostpt.com

**ORTHOPEDIC
SPINE THERAPY**

REVISION	DATE
x	xxx

DATE
9/5/2015
PROJECT NO.
451002

SHEET
**A
3.2**


PRELIMINARY
NOT FOR CONSTRUCTION



LaPlant Architecture, LLC

OFFICE: 926 WILLARD DRIVE GREEN BAY, WISCONSIN MAILING: 1592 RUSTIC WAY GREEN BAY, WISCONSIN 54313 Telephone: (920) 737-9769 EMAIL: laplantarchitecture@yahoo.com

Owner BMG Properties, LLC Zoning C1-General Commercial

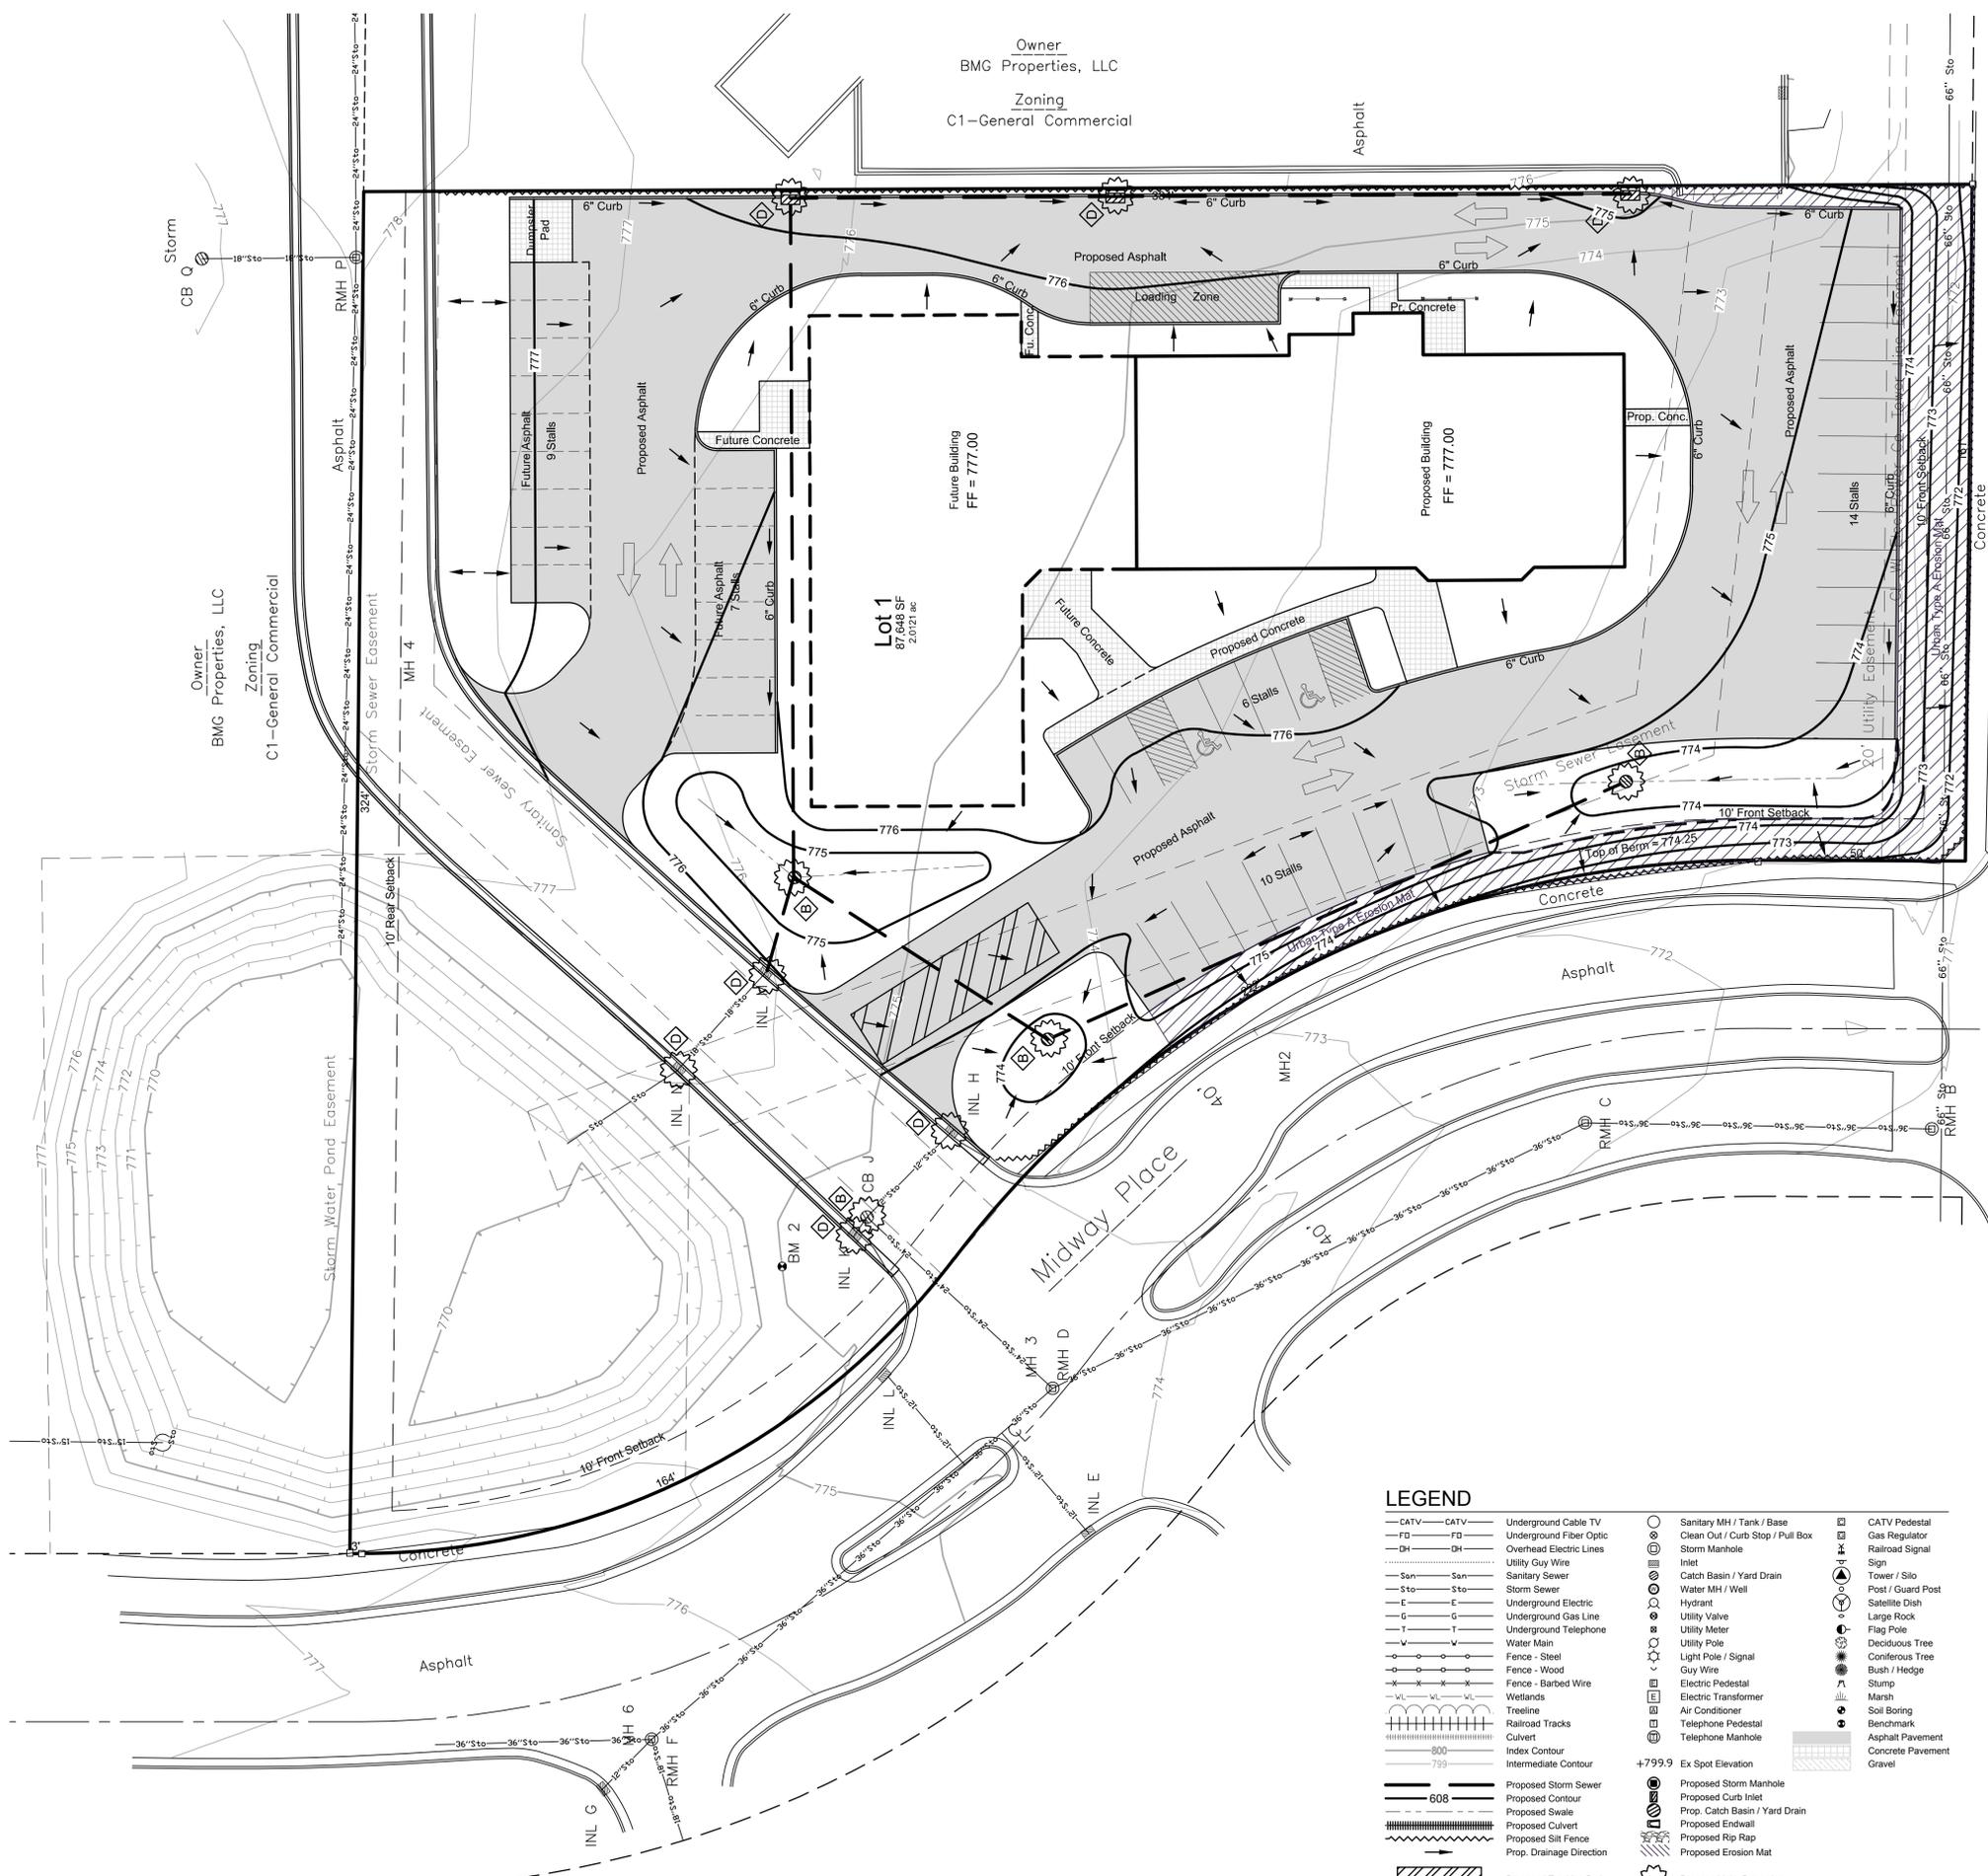

Planned Sediment and Erosion Control Practices

All erosion control practices shall be in place prior to disturbing the site. All sediment and erosion control devices and methods shall be in accordance with DNR Technical Standards and the WisDOT Erosion Control product acceptability lists (PAL). It is the responsibility of the Contractor to minimize the area disturbed and the duration of the disturbance. Erosion control measures shall be maintained on a continuing basis until the site is permanently stabilized. Erosion control measures shall be in place at the end of each work day with all off-site sediments being cleaned daily or as necessary as no sediment flushing is allowed.

- 1) Diverting Flow
a) Permanent Diversion - Intended to divert runoff around disturbed areas to a location where the water can be discharged without adversely impacting the receiving area or channel.
b) Temporary Diversion - Intended to divert runoff around disturbed areas to a location where the water can be discharged without adversely impacting the receiving area or channel.
2) Overland Flow
a) Perimeter Sediment Controls - Intended to provide a temporary barrier to the transportation of sediment offsite and also reduces the velocity of sheet flow...
3) Inlet Protection Barriers - Intended to prevent the sedimentation of storm water conveyance structures.
4) Stone Tracking Pad - Intended to reduce the amount of sediment transported onto public roads.
5) Dust Control - Intended to reduce surface to air transport of dust during construction.
6) Dewatering BMP - Intended to reduce the amount of sediment conveyed due to dewatering practices.


- Sequence of Construction
1) Obtain plan approval and other applicable permits.
2) Install and maintain all erosion control measures: September 2015
3) Site grading and utility work: September 2015
4) Construct foundation: September 2015
5) Grade and gravel construction of parking and drives: October 2015
6) Construct Building: October 2015
7) Concrete curbs, sidewalks, and asphalt paving: November 2015
8) Stabilize lawn and ditch areas no later than one week after final grade is established.
9) Watering may be necessary to establish healthy and well rooted vegetation.

Note: The dates provided are approximate and subject to weather conditions and overall project schedule. Several work items as listed above may occur simultaneously with others.

EROSION & SEDIMENT CONTROL PLAN

LEGEND

- CATV - CATV
FD - Underground Fiber Optic
OH - Overhead Electric Lines
UW - Utility Guy Wire
San - Sanitary Sewer
Sto - Storm Sewer
E - Underground Electric
G - Underground Gas Line
T - Underground Telephone
V - Water Main
Fence - Steel
Fence - Wood
Fence - Barbed Wire
Wetlands
Trestle
Railroad Tracks
Culvert
Index Contour
Intermediate Contour
Proposed Storm Sewer
Proposed Contour
Proposed Swale
Proposed Culvert
Proposed Silt Fence
Prop. Drainage Direction
Proposed Tracking Pad
Proposed Ditch Check
Sanitary MH / Tank / Base
Clean Out / Curb Stop / Pull Box
Storm Manhole
Inlet
Catch Basin / Yard Drain
Water MH / Well
Hydrant
Utility Valve
Utility Meter
Utility Pole
Light Pole / Signal
Guy Wire
Electric Pedestal
Electric Transformer
Air Conditioner
Telephone Pedestal
Telephone Manhole
Ex Spot Elevation
Proposed Storm Manhole
Proposed Curb Inlet
Prop. Catch Basin / Yard Drain
Proposed Endwall
Proposed Rip Rap
Proposed Erosion Mat
Proposed Inlet Protection
Type of Inlet Protection
CATV Pedestal
Gas Regulator
Railroad Signal
Sign
Tower / Silo
Post / Guard Post
Satellite Dish
Large Rock
Flag Pole
Deciduous Tree
Coniferous Tree
Bush / Hedge
Stump
Marsh
Soil Boring
Benchmark
Asphalt Pavement
Concrete Pavement
Gravel



DAVEL ENGINEERING & ENVIRONMENTAL, INC. CIVIL ENGINEERING CONSULTANTS
1811 Racine Street Menasha, WI 54952
Ph: 920-991-1866 Fax: 920-830-9595
www.davel.pro


PRELIMINARY NOT FOR CONSTRUCTION

Stansbury & Brady, LLC
Orthopedic Spine Therapy
OFFICE: 4000 N. PROVIDENCE APPLETON, WI 54913
Telephone: (920) 257-2005
EMAIL: abarnett@ostpt.com

Table with columns REVISION and DATE. Row 1: x, xxx. Row 2: DATE 09/08/2015, PROJECT NO. 4474, SHEET C 1.3



C 1.3

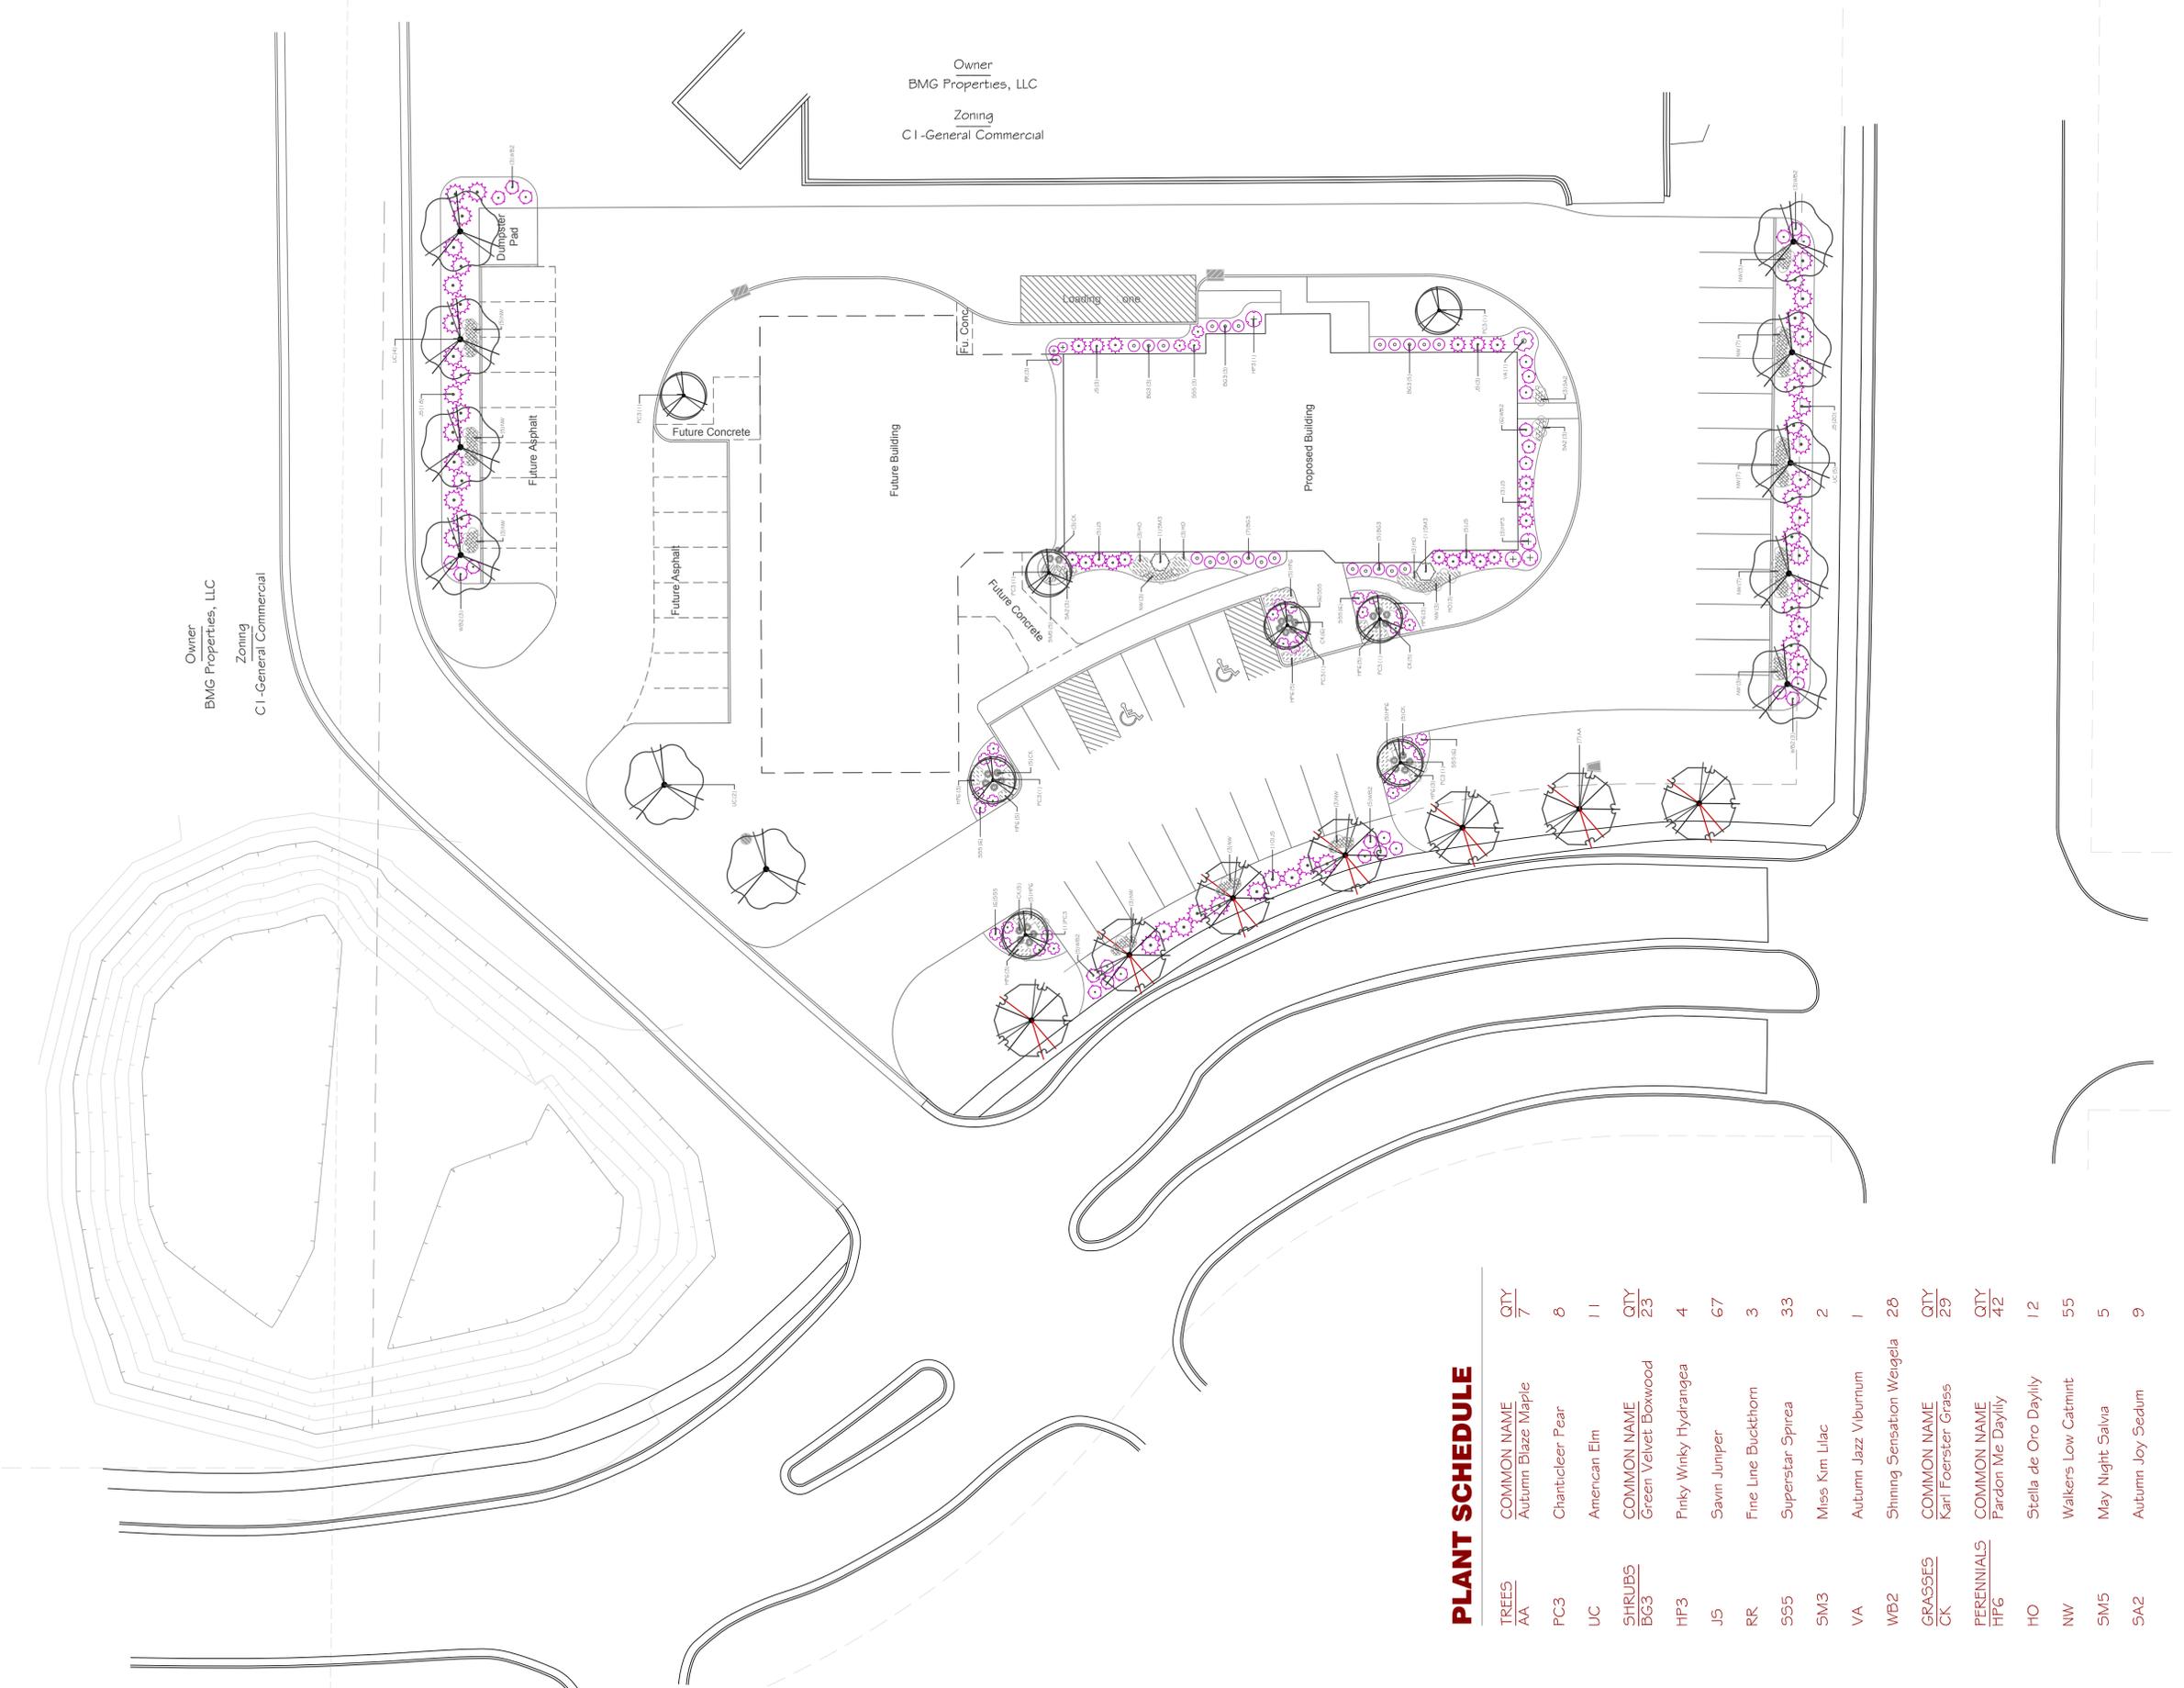

Owner
BMG Properties, LLC
Zoning
C1-General Commercial

Owner
BMG Properties, LLC
Zoning
C1-General Commercial

PLANT SCHEDULE

TREES	COMMON NAME	QTY
AA	Autumn Blaze Maple	7
PC3	Chanticleer Pear	8
UC	American Elm	11
SHRUBS	COMMON NAME	QTY
BG3	Green Velvet Boxwood	23
HP3	Pinky Winky Hydrangea	4
J5	Savin Jumper	67
RR	Fine Line Buckthorn	3
S55	Superstar Spirea	33
SM3	Miss Kim Lilac	2
VA	Autumn Jazz Viburnum	1
WB2	Shining Sensation Weigela	28
GRASSES	COMMON NAME	QTY
CK	Karl Foerster Grass	29
PERENNIALS	COMMON NAME	QTY
HP6	Pardon Me Daylily	42
HO	Stella de Oro Daylily	12
NW	Walkers Low Catmint	55
SM5	May Night Salvia	5
SA2	Autumn Joy Sedum	9



Schmalz
Custom Landscaping
and Garden Center

LANDSCAPE ARCHITECTURE
DEVELOPMENT
CONSTRUCTION
AWARD WINNING DESIGN
AND INSTALLATION

W2484 CTY RD KK
APPLETON, WI 54915-9464
PHONE 920-733-8223
FAX 920-733-3262
WWW.SCHMALZLANDSCAPING.COM

All ideas, designs, arrangements and plans indicated by this drawing are owned by, and are the property of Schmalz Custom Landscaping. None of these ideas, arrangements or plans shall be disclosed to any person, firm or contractor for any purpose without the written permission of Schmalz Custom Landscaping, Inc. Written agreements on this plan shall have precedence over scaled dimensions.

DO NOT SCALE
© 2009, Schmalz Custom Landscaping, Inc.



NORTH

Orthopedic Spine Therapy
Midway Road
Menasha, WI 54952




DATE: 06/15
REVISED:
PHONE NO.
EMAIL:
SCALE: 1" = 20'-0"
DRAWN BY:
NL5 JSJ
SHEET TITLE
Landscape Plan

SHEET NO. L-1
JOB # FILE NO.

ARIETA™13 LED Area Luminaire AR13

Luminaire Data

Weight 15.4 lbs [7 kg]
EPA 0.47 ft²

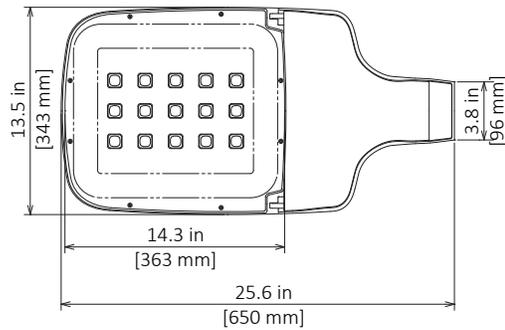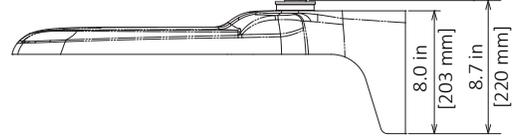

Ordering Information

Sample Catalog No. AR13 6M MV NW 5 BK 700 MSL3

Product	LED No. & Type	Voltage ⁹	Nominal Color Temperature ²	Distribution	Finish ³	Drive Current ⁴	Options
AR13	4M	MV 120-277V	NW 4000K	2 Type 2	BK Black	350 350mA	BSK Bird Spider Kit
	6M	HV 347-480V	CW 5000K	3 Type 3	DB Dark	530 530mA	RPA Round Pole Adaptor
	10M			4 Type 4	Bronze	700 700mA	HSS ⁵ House Side Shield
	15M			5 Type 5	WH White		FDC ⁶ Fixed Drive Current
	18M						PCR NEMA Photocontrol Receptacle
	20M ¹						PCR5 ANSI 5-wire Photocontrol Receptacle
							PCR7 ANSI 7-wire Photocontrol Receptacle
							SC PCR Shorting Cap
							MSL7 ⁷ Motion Sensor with L7 Lens
							MSL3 ⁷ Motion Sensor with L3 Lens
							FSIR100 Motion Sensor Configuration Tool
							PPS ⁸ Programmable Power Supply
							ORR Optics Rotated Right
							ORL Optics Rotated Left
							WL Utility Wattage Label

Notes:

- 1 20M available with MV only
- 2 4000K and 5000K standard, consult factory for other color temperatures.
- 3 Black, Dark Bronze or White standard, consult factory for other finishes.
- 4 Factory set drive current, field adjustable standard. Refer to performance data on page 3.
- 5 Flush mounted shield factory installed, also available for field installation. House Side Shield cuts light off at 1/2 mounting height behind luminaire.
- 6 Non-field adjustable drive current. Specify 350mA, 530mA or 700mA setting.
- 7 Motion Sensor available with MV only. Motion Sensor default setting dims luminaire to 50% when no motion detected for 5 minutes. Field adjustable using FSIR100 for alternate settings. See L7 or L3 Lens coverage details on page 4. Consult factory for MS specified with ANSI 5-wire or 7-wire Photocontrol Receptacle. Luminaire warranty is limited to 5 years with a Motion Sensor. PCR option is required for On/Off control using light detection.
- 8 Consult factory for programming.
- 9 MV is DLC qualified. HV is DLC qualified on request, consult factory.



ARIETA™13 LED Area Luminaire

AR13

Luminaire Specifications

Housing

Die cast aluminum housing with universal mounting design allows for attachment to existing pole without redrilling for retrofit applications. Square pole mounting standard, round pole adapter option available. Meets 3G vibration per ANSI C136. All hardware is stainless steel. Electrical components are accessed without tools and are mounted on removable power door. Power door features quick electrical disconnects to terminal block and LED board.

Light Emitting Diodes

Hi-flux/Hi-power white LEDs produce a minimum of 95% of initial intensity at 100,000 hours of life. LEDs are tested in accordance with IES LM-80 testing procedures. Mean correlated color temperature of 4000K (standard) and 70 minimum CRI. LEDs are 100% mercury and lead free.

Performance Data

See next page

Optical Systems

Micro-lens systems produce IES Type 2, Type 3, Type 4 or Type 5 distributions. Luminaire produces 0% total lumens above 90° (BUG Rating, U=0).

Electrical

Power Supply drive current is field adjustable (350mA, 530mA or 700mA). 0-10V dimmable power supply is standard. Power supply features a minimum power factor of .90 and <20% Total Harmonic Distortion (THD). EMC meets or exceeds FCC CFR Part 15. Transient voltage complies with ANSI C62.41 Cat. A. Integral surge protector is tested per ANSI/IEEE C62.45 procedures based on ANSI/IEEE C62.41.2 definitions for standard and optional waveforms for Location Category C High. Photocontrol receptacle or ANSI C136.41 5-wire or 7-wire dimming receptacle is optional. Standard and optional photocontrol receptacles have tool-less rotatable base. Photocontrol or control module is provided by others.

Finish

Housing receives a fade and abrasion resistant, epoxy polyester powder coat.

Listings/Ratings/Labels

Luminaires are UL listed for use in wet locations in the United States and Canada. Optical systems maintain an IP66 rating. DesignLights Consortium™ qualified 4000K product. Assembled in the United States. Wattage label complies to ANSI C136.15-2011. Luminaire is qualified to operate at ambient temperatures of -40°C to 40°C.

Photometry

Luminaires are photometrically tested by certified independent testing laboratories in accordance with IES LM-79 testing procedures.

Warranty

10-year limited warranty is standard on all luminaires and components. 5-year Limited Warranty on luminaires with a motion sensor.

ARIETA™13 LED Area Luminaire

AR13

Performance Data

All data nominal, consult factory for IES files or LM-79 reports.

No. of LEDs & Type	Drive Current (mA)	System Wattage (W)	Type 5		
			Delivered Lumens (Lm)	Efficacy (Lm/W)	BUG Rating
4M	350*	18	2170	121	B2 U0 G1
	530	28	3080	110	B2 U0 G1
	700	37	3850	104	B2 U0 G1
6M	350	26	3120	120	B2 U0 G1
	530	39	4430	114	B2 U0 G1
	700	52	5530	106	B3 U0 G1
10M	350	43	5190	121	B3 U0 G1
	530	65	7380	114	B3 U0 G1
	700	86	9210	107	B3 U0 G2
15M	350	65	7790	120	B3 U0 G1
	530	97	11080	114	B3 U0 G2
	700	129	13818	107	B4 U0 G2
18M	350	78	9340	120	B3 U0 G2
	530	116	13290	115	B4 U0 G2
	700	155	16580	107	B4 U0 G2
20M	350*	87	10380	119	B3 U0 G2
	530	129	14770	114	B4 U0 G2
	700	172	18420	107	B4 U0 G2

Note:

* DLC qualification at 350mA limited to 120-240V

ARIETA™13 LED Area Luminaire AR13

Motion Sensor (Optional) Specifications

Description

Digital passive infrared luminaire integrated outdoor occupancy sensor provides high/low/off control based on motion detection. Initial setup and subsequent sensor adjustments are made using a handheld configuration tool. PCR option is required for On/Off control using light detection.

Operation

Standard factory setting will dim the luminaire to 50% until motion is sensed and then it will power to 100%. When motion is not detected for five minutes, the luminaire will dim back to 50%. Ramp up and fade down times are adjustable, but initially set to NONE. The percent dimming and time durations may be field adjusted as required using FSIR-100 configuration tool. FSIR-100 user guide available at: www.wattstopper.com.

Optical System

Multi-cell, multi-tier Fresnel lens with a 360 degree view detects unobstructed motion within one mounting height, up to 20ft maximum (standard). Consult factory for higher mounting height requirements.

Finish

Sensor exterior ring and lens are white polycarbonate, UV and impact resistant.

Listings/Ratings


Sensor is TUV, UL and cUL listed, IP66 rated and CE compliant.

Warranty


5-year limited warranty on luminaires and components with a motion sensor.

Motion Sensor (Optional) Data


L3 Lens Dimensions

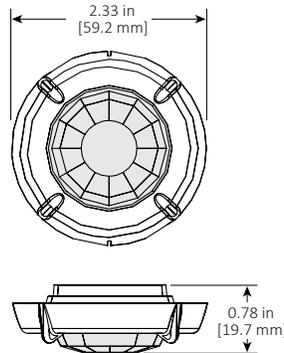


L3 Lens Coverage Top View

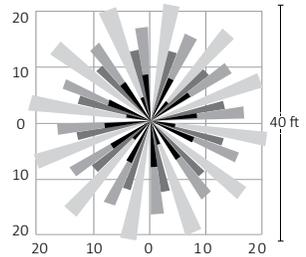


L3 Lens Coverage Side View

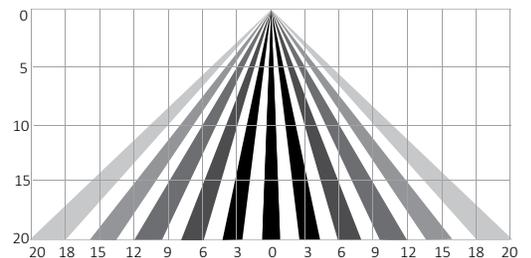


L7 Lens Dimensions

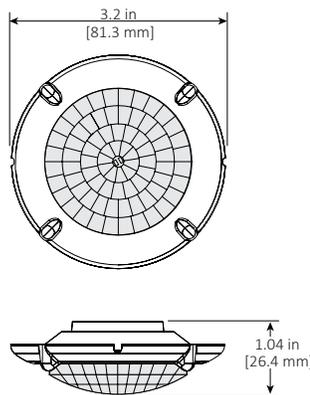


L7 Lens Coverage Top View

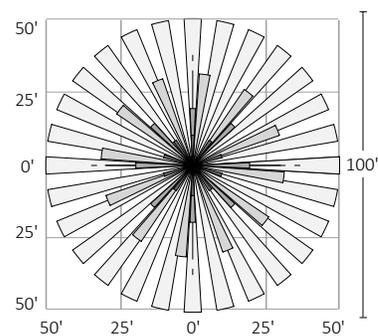

L7 Lens Coverage Side View

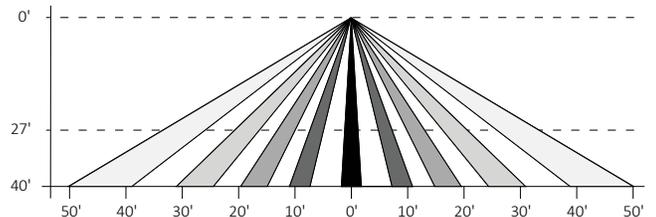

Square Straight Steel Light Poles

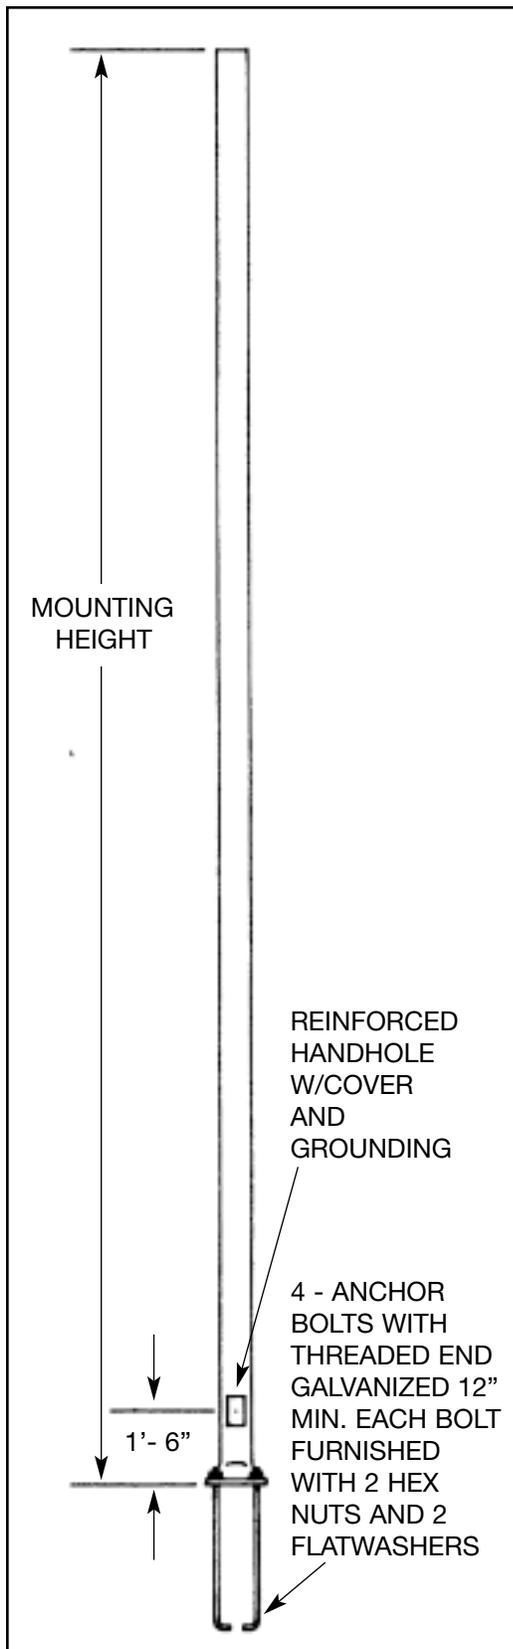

POLE SHAFT:

Weldable grade hot rolled commercial quality carbon steel with minimum yield strength of 55,000 PSI.

ANCHOR BASE:

Structural quality ASTM A36

ANCHOR BOLTS:

Carbon steel conforming to AASHTO M314 Grade- 55 or ASTM F1554 Grade - 55. Bolts are "L" shaped and are galvanized a minimum of 12" on the threaded end. Each pole includes four bolts each with two nuts and two flat washers.

FULL BASE COVER:

Two piece cover fabricated from ABS plastic secured together with two plastic hand push rivets.

HANDHOLE:

Covered 2 1/2" x 5" reinforced handhole. A nut holder is provided near the handhole and includes a 1/2 - 13 UNC hex head bolt and nut.

HARDWARE:

All structural fasteners are galvanized high strength carbon steel. All other fasteners are galvanized or zinc plated or stainless steel.

STANDARD FINISH:

Galvanized or powder coated. Consult factory for standard or custom colors.


MOUNTINGS OPTIONS:

Tenons-standard 2 3/8" x 4" or 4" x 6" or removable pole cap used in conjunction with side mounted fixtures.

*Serving our customers and
the industry with quality
products since 1973.*

Square Straight Steel Light Poles

POLE CATALOG NUMBER	NOMINAL MOUNTING HEIGHT (ft)	SHAFT SIZE INCHES	WALL THK. GAUGE	BOLT CIRCLE	ANCHOR BOLTS (IN)	Max EPA AT: (Allows for 1.3 Gust Factor)		
						80 MPH	90 MPH	100 MPH
SSS10-404C	10'	4	11	8.5	0.75 X 17 X 3	30.6	23.8	18.9
SSS12-404C	12'	4	11	8.5	0.75 X 17 X 3	24.4	18.8	14.8
SSS14-404C	14'	4	11	8.5	0.75 X 17 X 3	19.9	15.1	11.7
SSS15-404C	15'	4	11	8.5	0.75 X 17 X 3	17.9	13.1	10.5
SSS16-404C	16'	4	11	8.5	0.75 X 17 X 3	15.9	11.8	8.9
SSS18-404C	18'	4	11	8.5	0.75 X 17 X 3	12.6	9.2	6.7
SSS20-404C	20'	4	11	8.5	0.75 X 17 X 3	9.6	6.7	4.5
SSS20-404D	20'	4	7	8.5	0.75 X 17 X 3	15.8	12.7	9.0
SSS20-505C	20'	5	11	11	0.75 X 17 X 3	17.7	12.7	9.4
SSS20-505D	20'	5	7	11	.75 X 17 X 3	28.1	21.4	16.2
SSS25-404C	25'	4	11	8.5	0.75 X 17 X 3	4.8	2.6	1.0
SSS25-404D	25'	4	7	8.5	0.75 X 17 X 3	10.8	7.7	5.4
SSS25-505C	25'	5	11	11	0.75 X 17 X 3	9.8	6.3	3.7
SSS25-505D	25'	5	7	11	0.75 X 17 X 3	18.5	13.3	9.5
SSS30-505C	30'	5	11	11	0.75 X 17 X 3	4.7	2.0	-
SSS30-505D	30'	5	7	11	0.75 X 17 X 3	10.7	6.7	3.9
SSS30-606D	30'	6	7	12	1 X 36 X 4	19.0	13.2	9
SSS35-505D	35'	5	7	11	0.75 X 17 X 3	5.9	2.5	-
SSS35-606D	35'	6	7	12	1 X 36 X 4	12.4	7.6	4.2
SSS40-606D	40'	6	7	12	1 X 36 X 4	7.2	3.0	-

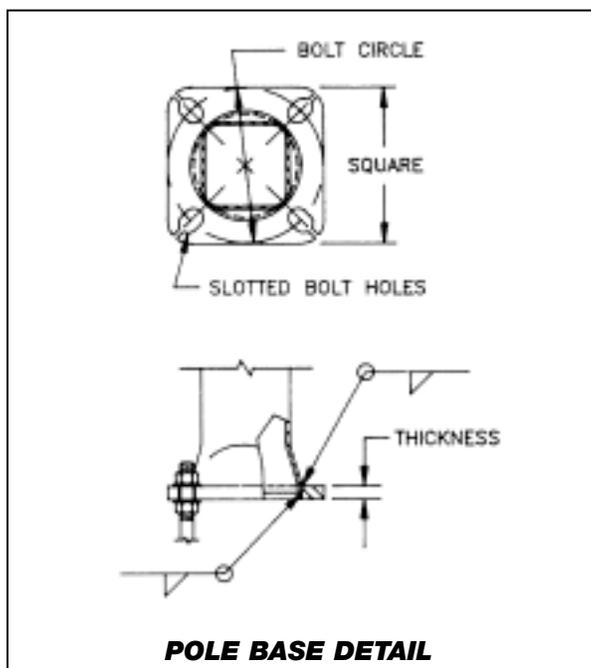

POLE BASE DETAIL

BASE PLATE

- 4" - 11 GAUGE - 8 1/2" SQ. X 3/4" THICK
- 4" - 7 GAUGE - 8 1/2" SQ. X 7/8" THICK
- ALL 5" - 11" SQ. X 1" THICK
- ALL 6" - 12" SQ. X 1" THICK

Dimensions and Specifications subject to change without notice.