

Carol A. Schmidt

From: AAuxier@nmfire.org
Sent: Tuesday, January 25, 2011 6:52 AM
To: Carol A. Schmidt
Cc: Mark Radtke
Subject: Fw: NMFR - 101520 - Mods for Approval #18.01 and #20
Attachments: NMFR Mod #18-01.pdf; NMFR Mod #20.pdf

Good Morning Carol,

You haven't heard from me in awhile so I figured it's about time for me to start bothering you again. Below you will find a email from Jill Kordus, Miron Construction that has two change orders for the new Station #36 attached. Could you please put change orders NMFR Mod #18-01 and NMFR Mod #20 on the agenda for the Public Works Committee. There will be a total of two emails that I am sending to you with a total of three change orders. Could you please let me know if everything looks OK.

Thank you!

Al Auxier
Fire Chief
Neenah-Menasha Fire Rescue
aauxier@nmfire.org
(920)886-6203, office
(920)209-9509, cell

----- Forwarded by Al E. Auxier/Fire/Neenah on 01/25/2011 06:35 AM -----

From: Jill.Kordus@Miron-Construction.com
To: sborsechnik@griesarchitectural.com
Cc: aauxier@nmfire.org, DSchultz@nmfire.org
Date: 01/24/2011 03:30 PM
Subject: NMFR - 101520 - Mods for Approval #18.01 and #20

Steve,
Please see attached Mod #18-01 and #20 for review and approval.

Thank you,
Jill

Jill Kordus
Project Coordinator
Miron Construction Co., Inc
1471 McMahon Drive
Neenah, WI 54956

Phone: (920)-969-7008
Fax: (920)-969-7399
jill.kordus@miron-construction.com



JOB #:101520
MOD #: 0020 -00
DATED: 1/24/11

Building Excellence™

CHANGE ORDER REQUEST

TO: Mr Steve Borsecnik
Gries Architectural Group
500 N Commercial St
Neenah WI 54956

FAX: 920-722-6605
PHONE: 920-722-2445

RE: Neenah Menasha Fire
Rescue Station 36
1108 Province Terrace
Menasha WI 54952

DESCRIPTION OF MODIFICATION:

Insulate Vehicle Exhaust ductwork above ceiling to reduce condensation.

REQUESTED BY: _____ DATE: _____

SUBCONTRACTOR

AMOUNT

Miron Construction Co., Inc
Thermo Tech:

	\$605.00	
Subtotal		\$605.00
	Subtotal	\$605.00

TOTAL AMOUNT OF THIS MODIFICATION: \$605.00

CHANGE ORDER AMOUNT REQUESTED: =====
\$605.00

Please find back up materials enclosed regarding this modification.

Contractor is (not) to proceed with the work as noted above. The contract with the Owner is adjusted as follows:

Approved Cost _____ Schedule Impact _____

Miron Representative Paul A. Riederer Date 1/24/11
Paul A. Riederer

Owner Representative _____ Date _____

THIS PRICE IS VALID FOR 15 DAYS FROM THE DATE SHOWN

Copy: File/jak
Jobsite
Dan Schultz
Al Auxier



Neenah / Menasha Fire Rescue
Steve Listle to: paul.riederer

01/24/2011 10:38 AM

Paul,

Please consider the following revision;

Provide and install 1 1/2" thick flexible fiberglass duct insulation with a factory-applied FSK vapor-barrier facing on Vehicle Exhaust Ductwork located in attic, per information and quantities provided.

Quantities

8" dia.	55 lf	1-90	2-45's
6" dia.	20 lf	2-90's	

TOTAL PRICE: \$605.00

Revised pricing includes State mandated labor rates.

Thank you for your consideration. If you have any questions, feel free to contact me.

Steve



QC Ductwrap.pdf




INNOVATIONS FOR LIVING™

SOFTR®

All Service Fiber Glass Duct Wrap

Product Data Sheet

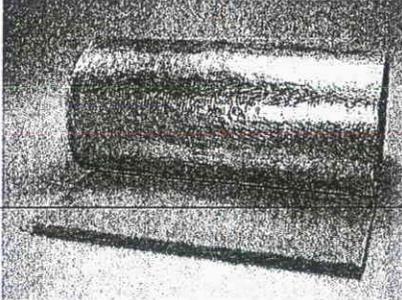

Availability and Installed R-Values

Standard roll width: 48" (1.2m)

Installed R (RSI) values: When installed in accordance with recommended installation procedures, SOFTR® All Service Fiber Glass Duct Wrap will provide installed R (RSI) values as follows:

Nominal Thickness		Out-of-Package R (RSI) Value ¹		Installed Thickness ²		Installed R (RSI) Value ^{1,2}	
in.	mm			in.	mm		
Type 75 – 0.75 pcf (12 kg/m³)							
1½	(38)	5.1	(0.90)	1½	(38)	4.2	(0.74)
2	(51)	6.8	(1.20)	1½	(38)	5.6	(0.99)
2½	(64)	7.4	(1.30)	1½	(38)	6.0	(1.06)
2½	(64)	8.0	(1.41)	1½	(38)	6.5	(1.14)
2½	(64)	8.3	(1.46)	1½	(38)	6.9	(1.22)
3	(76)	10.0	(1.76)	2¼	(57)	8.3	(1.46)
3½	(89)	11.0	(1.94)	2½	(64)	9.7	(1.71)
4	(102)	13.25	(2.33)	3	(76)	11.0	(1.94)
Type 100 – 1.00 pcf (16 kg/m³)							
1½	(38)	5.6	(0.99)	1½	(38)	4.5	(0.79)
2	(51)	7.4	(1.30)	1½	(38)	6.0	(1.06)
Type 150 – 1.50 pcf (24 kg/m³)							
1½	(38)	6.0	(1.06)	1½	(38)	4.8	(0.85)
2	(51)	8.0	(1.41)	1½	(38)	6.4	(1.13)

¹hr•ft²•°F/Btu (m²•°C/W) at 75°F (24°C) mean temperature.

²Assumes 25% compression of insulation.

Description

SOFTR® All Service Fiber Glass Duct Wrap is a blanket of glass fiber insulation factory-laminated to FRK vapor retarder facing. A 2" (50mm) stapling and taping flange is provided on one edge. This product is designed to meet existing performance standards such as NFPA 90A and 90B and other model building and energy codes.

Uses

SOFTR® All Service Fiber Glass Duct Wrap is used for external insulation of commercial and residential heating, air conditioning and dual-temperature ducts operating at temperatures from 40°F (4°C) to 250°F (121°C). This insulation, when applied in accordance with installation instructions, will provide the "installed R-value" as published for the product and printed on the facing, assuring specified in-place thermal performance and condensation control.

Product Attributes

Assured Thermal Performance
When installed in accordance with instructions so that compression is controlled,

Specification Compliance

ASTM C 1290, Flexible Fibrous Glass Blanket Insulation Used to Externally Insulate HVAC Ducts, Type III

ASTM C 1136, Flexible Low Permeance Vapor Retarders for Thermal Insulation, Type II (facing only)

ASTM C 553,*Mineral Fiber Thermal Insulation: Type I – Fiberglas® Duct Wrap Type 75; Type II – SOFTR® All Service Fiber Glass Duct Wrap Types 100 and 150. (Operating temperatures to 250°F (121°C) and thermal values to 150°F (66°C) mean.

* Preferred specification is ASTM C 1290.

NOTE TO SPECIFIERS – Federal Specification HH-1-558B (Amendment 3), Form B (covering the duct wrap), and Federal Specification HH-B-100B (Covering the facing and CAN/CGSB-51.11), are obsolete. These are replaced by the above referenced ASTM specifications.

Physical Property Data

Property	Test Method	Value		
Operating Temperature	ASTM C 411	up to 250°F (121°C)		
Insulation Jacket Temperature Limit	ASTM C 1136	up to 150°F (66°C)		
Jacket Puncture Resistance	ASTM C 1136	25 units (0.7 joules)		
Water Vapor Permeance	ASTM E 96*	0.02 perms		
Water Vapor Sorption	ASTM C 1104	<3% by weight at 120°F (49°C), 95% R.H.		
Fungi Resistance	ASTM C 1338	Meets requirements		
Thermal Conductivity K at 75°F Mean, Btu•in/hr•ft ² •°F (λ at 24°C Mean, W/m•°C)	ASTM C 518	Type 75 0.30 (0.043)	Type 100 0.27 (0.039)	Type 150 0.25 (0.036)
Surface Burning Characteristics Flame Spread	ASTM E 84*	25*		
Smoke Developed		50		

*The surface burning characteristics of these products have been determined in accordance with ASTM E 84, CAN/ULC S102. This standard should be used to measure and describe the properties of materials, products or assemblies in response to heat and flame under controlled laboratory conditions and should not be used to describe or appraise the fire hazard or fire risk of materials, products or assemblies under actual fire conditions. However, results of this test may be used as elements of a fire risk assessment which takes into account all of the factors which are pertinent to an assessment of the fire hazard of a particular end use. Values are reported to the nearest 5 rating.



INNOVATIONS FOR LIVING™

SOFTR®

All Service Fiber Glass Duct Wrap

Product Data Sheet

SOFTR® All Service Fiber Glass Duct Wrap provides specified thermal performance. See R-value table. Operating costs are controlled due to reduction of heat loss or gain through duct walls.

Condensation Control
SOFTR® All Service Fiber Glass Duct Wrap helps control moisture condensation on the ductwork as well as on the outer vapor retarder jacket. This helps maintain insulation efficiency and reduces the likelihood of stained ceilings due to moisture damage.

Enhanced Comfort Control
SOFTR® All Service Fiber Glass Duct Wrap helps heating and cooling systems to deliver conditioned air to occupied spaces at or near design temperatures. By conserving heating and cooling energy, HVAC systems may operate under reduced load.

Meets Model Energy and Mechanical Codes
SOFTR® All Service Fiber Glass Duct Wrap, when correctly installed, complies with model building and energy codes and standards including ASHRAE 90.1 and 90.2. Architects, contractors, code officials and owners are assured of compliance and "no-problem" inspection. Application of insulation is the responsibility of the engineer and contractor.

Flexible and Easy to Install
SOFTR® All Service Fiber Glass Duct Wrap is easily cut and fit to flat, curved or irregular duct surfaces for a neat, thermally effective insulation blanket.

Because it's easier to install than rigid boards, installation costs are lowered.

Facings

The facing on Owens Corning SOFTR® All Service Fiber Glass Duct Wrap is a Foil Reinforced Kraft (FRK) low permeance vapor retarder meeting the requirements of ASTM C 1136, Type II.

Condensation Control


To determine thickness to prevent condensation at various ambient temperature and humidity levels, based on installed thickness 75% of nominal (out-of-package) thickness, 55°F (13°C) air duct internal temperature:

1. Select maximum expected relative humidity (R.H.) on the lower scale.
2. Move up vertically until that line intersects the expected maximum ambient air temperature.
3. Select the thickness indicated by the intersection point.
4. Specified design thickness should be adequate to prevent exterior surface condensation.

Limitations


SOFTR® All Service Fiber Glass Duct Wrap is not recommended for use on duct systems subject to continuous service at temperatures in excess of 250°F (121°C). It should not be used in conditions where condensation might occur on the FRK facing nor exposed to weathering or mechanical abuse without proper protection. It should not be used on the inside of ducts.

Thermal Conductivity

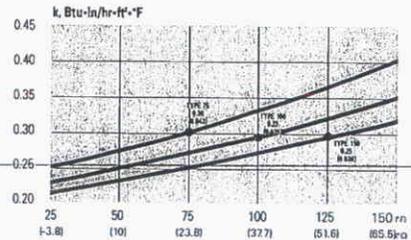

Apparent thermal conductivity curve determined in accordance with ASTM Practice C 1045 with data obtained by ASTM Test Method C 177. Values are nominal, subject to normal testing and manufacturing tolerances.

Nominal Duct Wrap Thickness to Prevent Surface Condensation

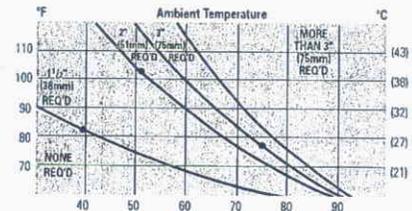

The above chart is based on indoor conditions so far as wind and other factors are concerned

Application Recommendations

Before applying SOFTR® All Service Fiber Glass Duct Wrap, ducts shall be clean, dry and tightly sealed at all joints and seams. SOFTR® All Service Fiber Glass Duct Wrap shall be cut to "stretch-out" dimensions and a 2" (50mm) (approx.) piece of duct wrap removed from the facing at the end of the piece of duct wrap to form an overlapping staple and tape flap, as shown below.

Install duct wrap tightly butted with facing outside. Overlap 2" (50mm) formed tape flap and facing at other end of piece of duct wrap. If ducts are rectangular or square, install



INNOVATIONS FOR LIVING™

SOFTR®

All Service Fiber Glass Duct Wrap

Product Data Sheet

so insulation is not excessively compressed at duct corners. Seams shall be stapled 6" (150mm) (approx.) on center with outward clinching staples. Adjacent sections of duct wrap shall be tightly butted with the 2" (50mm) tape flap overlapping.

Where a vapor retarder is required, seal all seams and joints with pressure-sensitive tape matching the facing (either plain foil or FRK backing stock) or with glass fabric and mastic. Cloth duct tape of any color and finish using reclaimed rubber adhesives is not recommended for use on SOFTR® All Service Fiber Glass Duct Wrap.

Where rectangular ducts are 24" (600mm) in width or greater, duct wrap shall be additionally secured to the bottom of the duct with mechanical fasteners such as pins and speed clip washers, spaced on 18" (425mm) centers (maximum) to prevent sagging of insulation.

It is neither necessary nor desirable to adhere duct wrap to duct surfaces.


Where a vapor retarder is required, seal all tears, punctures and other penetrations of the duct wrap facing using one of the above methods to provide a vapor-tight system.

The installed R-value is based on installation of product over sealed sheet metal ductwork with the average installed thickness at 75% of nominal thickness and thermal conductivity (k) at the installed compressed density.

Material Requirements to Achieve Installed R-Value

Nominal Thickness		Installed Thickness		Stretch Out Dimensions, in. (mm)					
in.	(mm)	in.	(mm)	Round and Oval Ducts		Square Ducts		Rectangular Ducts	
1½	(38)	1¼	(29)	P+9½	(240)	P+8	(205)	P+7	(180)
2	(51)	1½	(38)	P+12	(305)	P+10	(255)	P+8	(205)
2½	(56)	1¾	(41)	P+13	(330)	P+11	(280)	P+8½	(215)
3	(76)	2¼	(57)	P+17	(430)	P+14½	(370)	P+11½	(290)
4	(102)	3	(76)	P+22	(560)	P+19	(483)	P+16	(406)

P = measured duct perimeter

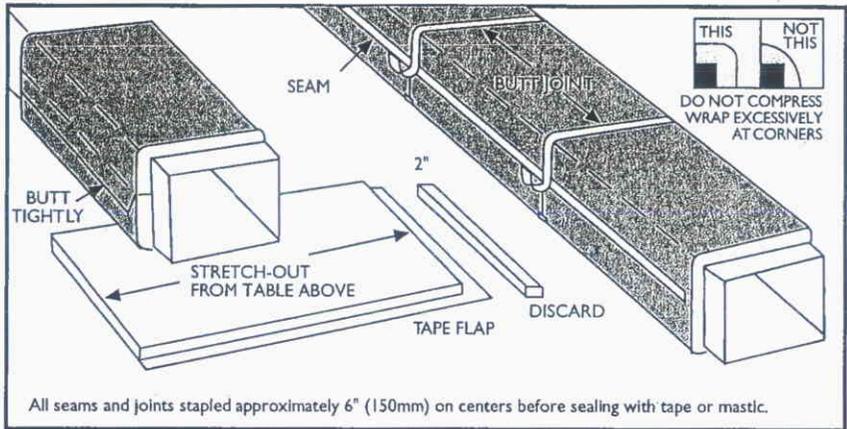

All seams and joints stapled approximately 6" (150mm) on centers before sealing with tape or mastic.

